

IEC

IECEE



TM

Ref. Certif. No.

CN65684

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT  
(IECEE) CB SCHEME

## CB TEST CERTIFICATE

Switch-disconnector

Shanghai Sieyuan Low Voltage Switch Co.,Ltd  
Room 304, Building NO.1, 3399Huaning Road, Minhang  
District, Shanghai,P.R.China

Shanghai Sieyuan Low Voltage Switch Co.,Ltd  
Room 304, Building NO.1, 3399Huaning Road, Minhang  
District, Shanghai,P.R.China

Shanghai Sieyuan Low Voltage Switch Co.,Ltd  
Building 25, No. 3333 Hua Ning Road, Xinzhuang Industrial  
Zone, Minhang District, Shanghai,P.R.China

See the Appendix

Sieyuan

N/A

SYW6GZ-4000;

IEC 60947-1:2020;IEC 60947-3:2020

00901-CB2024CQC-112908

### CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86-10-83886666 Fax: +86-10-83886282

website: <http://www.cqc.com.cn>

Date:

Apr.23,2024

Signature:

谢肇煦

Xie ZhaoXu



SYW6GZ-4000

Ui:1500V;Uimp:12kV;Ith:4000A;

Ue:DC750V,DC1000V,DC1500V(2P appearance);


Ie:1600A,2000A,2500A,3200A,3600A,4000A;

Utilization category:DC-21B,DC-PV1;

Icw:55kA/1s,150kA/0.2s;Icm:55kA;

IP20(only for working face);

DC diagram:

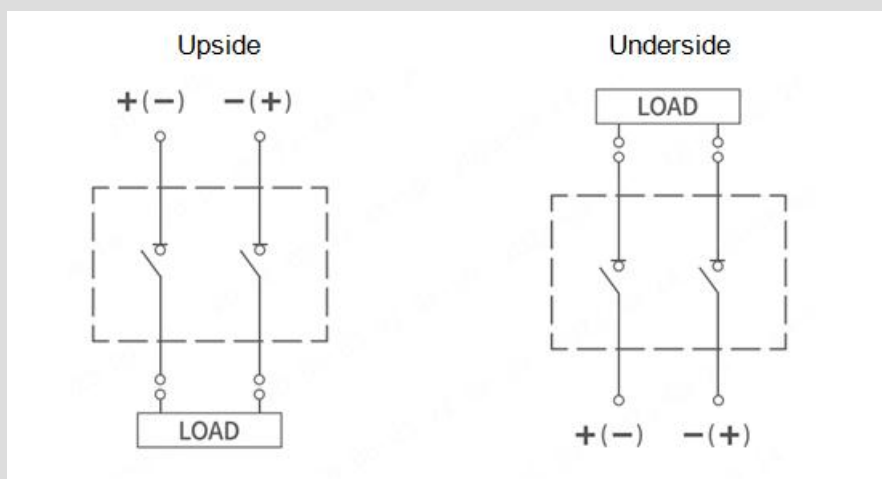

Auxiliary contacts:

4NO4NC,6NO6NC;

Ui:660V;Uimp:6kV;Ith:6A;

AC-15:Ue/Ie:AC380V/0.95A;

DC-13:Ue/Ie:DC220V/0.63A.

Page 1 of 1

Additional information (if necessary)

Date:

Apr.23,2024

Signature:

  
Xie ZhaoXu